

SEVCO SURVEY QUICK START


Go to:

<http://sevco.fwebb.com/>


Click on tab labeled: "SCVSS"



Sign in using your Username and Password or **Test Our Program!**

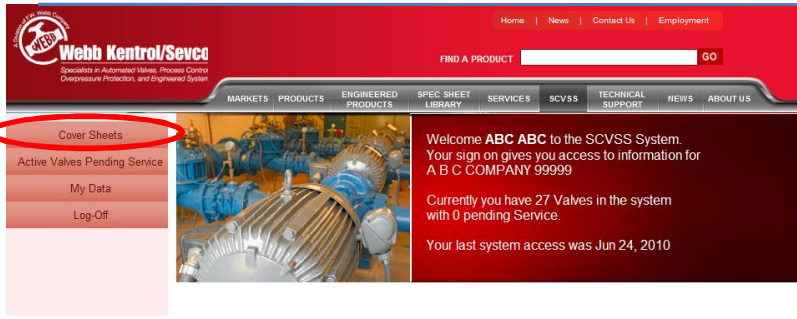

Click on "Cover Sheets" to open up the data base unique to your plant

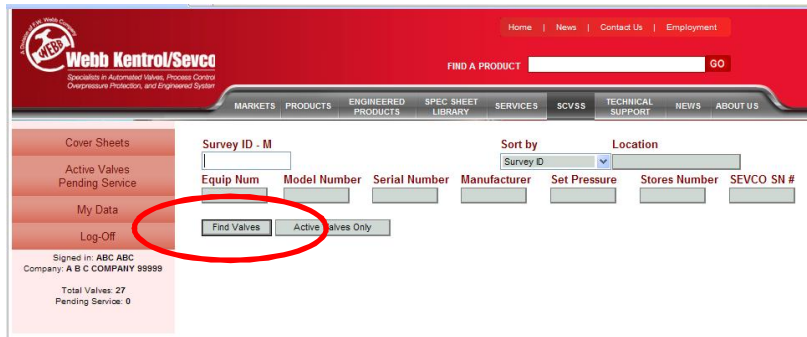

Click on "Find Valves" to see your valve population

Webb Kontrol/Sevco
Specialists in Automated Valves, Process Control
Overpressure Protection, and Engineered Systems

Home | News | Contact Us | Employment

FIND A PRODUCT GO

MARKETS PRODUCTS ENGINEERED PRODUCTS SPEC SHEET LIBRARY SERVICES **VALVES** TECHNICAL PORT NEWS ABOUT US

Cover Sheets
Active Valves
Pending Service
My Data
Log-Off

Signed In: ABC ABC
Company: A B C COMPANY 99999

Total Valves: 27
Pending Service: 0

Survey ID: M Sort by: Location

Equip Num	Model Number	Serial Number	Manufacturer	Set Pressure	Stores Number	SEVCO SN #
27 Valves have been found and below is 1 to 20						
05-00010-000	CDE DRUM	1787B2S	XX02967	CONSOLIDATED	1450	NA
05-00020-000	CDE DRUM	1787A2S	XX26996	CONSOLIDATED	1460	
05-00030-000	CDE SH	1787WC2S	XX02971	CONSOLIDATED	1390	NA
05-00040-000	PSV-B2	1747B2S	XX12345	CONSOLIDATED	650	NA
10-00010-000	PSV-B1	HCR-58	FAS00989-01	CROSBY	655	NA
10-00015-000	PSV-SH1	HCR-58	FAS89765-01	CROSBY	650	NA
BOILER #6 SUPERHEATER: 3 L2 6						

Valve population in groups of 20 is displayed with survey#, Model#, Set Pressure, etc.

Click on a specific valve to get detailed information about application & service history

Webb Kontrol/Sevco
Specialists in Automated Valves, Process Control
Overpressure Protection, and Engineered Systems

History Available

Company: 99999 Company: A B C COMPANY 99999

Survey ID: 05-00040-000 Srv Dt: 06/30/1996 Date: 06/24/2010

Purchased: 06/15/1996 Valve Stat: IN-SERVICE ASME Cd: SECTION I

Stores Num: NS Equip Num: PSV-B2 SEVCO SN: NA

Location: BOILER #6 NORTH DRUM : 3 X 6

Manufacturer: CONSOLIDATED Approx. Wt: 400 Lbs Model: 1747B2S

Mfg SN: XX12345 Mfg Shop #: NA Valve Size: 3 X 6

Set Pressure: 650.0 PSI Valve Type: SPRING LOADED PRV Temperature: SAT F

Capacity: 103781 PPH Spring Rg: 599-670

Spring No: 0463CR Body Mat: CARBON STEEL

AUX Test: Y Valve Trim: STAINLESS STEEL

Liquid Trm: N Connect: 1500# X 150#

Inlet Type: FLANGED Lever Type: OPEN

Outlet Type: FLANGED Last Service: SHOP : TEST ONLY

Installed: 06/20/1996 Recommended Service: FIELD : SERVICE

Last Service: 07/30/2008 Serv. Freq: 1 Next Service: 07/30/2009

Last VR Date: 11/25/2003

Comments:

Replacement Valve Information

This section shows specifics about valve manufacturer and application.

In addition, a replacement valve has been researched and selected

Webb Kontrol/Sevco
Specialists in Automated Valves, Process Control
Overpressure Protection, and Engineered Systems

2 Current History Records have been found.

SO #	Date	Company	Serial #	Survey ID
1	25-Nov-03	A B C COMPANY 99999	XX12345	05-00040-000
44444	20-Jul-03	A B C COMPANY 99999	XX12345	05-00040-000

Select a history record to print off report or look for trends/problems

SEVCO Incorporated
Heywood Rd Winslow, Maine 04901 - 207.873.7726 - www.fvwebb.com
Crosby Certified Pressure Management Center
Pressure Relief Valve Inspection, Test & Work Report

Date Received: 25-Nov-03 Date Required: 25-Nov-03 FIELD : REPAIR & TEST

Customer: A B C COMPANY 99999 - (Hershey, ME)

Sales Order #: 1 Customer P.O. #: TEST WDS Survey #: 05-00040-000

Valve Location: BOILER #6 NORTH DRUM : 3 X 6

Critical Data	As Found	As Left
Manufacturer: CONSOLIDATED	SEALS OK-WDS	REPLACED-WDS
Model: 1747B2S	MFG. NAMEPLATE OK-WDS	
Size: 3 X 6	LEVER ASSY OK-WDS	PAINT-WDS
MFG SN: XX12345	BODY/BASE OK-WDS	CLEANED/PAINTED-WDS
Set Pressure: 650.0 PSI	COMP. SCREW LOCK NUT OK-WDS	CLEANED/PAINTED-WDS
Capacity: 103781 PPH	COMPRESSION SCREW OK-WDS	CLEANED/PAINTED-WDS
Service: SAT STEAM	COVER PLATE ASSY OK-WDS	CLEANED/PAINTED-WDS
Body Material: CARBON STEEL	DISC OK-WDS	CLEANED & LAPPED-WDS
Trim: STAINLESS STEEL	DISC COLLAR OK-WDS	CLEANED-WDS
Spring #: 0463CR	DISC HOLDER OK-WDS	CLEANED-WDS
Spring Range: 599-670	DISC RETAINER OK-WDS	CLEANED-WDS
Operating Temp: SAT F	GASKETS OK-WDS	REPLACED-WDS
ASME Code: SECTION I	GUIDE DIRTY-WDS	CLEANED-WDS
Last Repair by: SEVCO	LAR OK-WDS	CLEANED & LUBED-WDS
Last Repaired: 06/30/1996	LARP BROKEN-WDS	REPLACED-WDS
Lever Type: OPEN	LIFT COLLAR OK-WDS	CLEANED & LUBED-WDS
	NOZZLE DIRTY-WDS	CLEANED & LAPPED-WDS
	OVERLAP COLLAR OK-WDS	CLEANED-WDS

Reset Data

Copy of Test & Work Report will be displayed.

These reports are the hard copies provided to customers after a service has been performed.